



HALF SECTION A-A

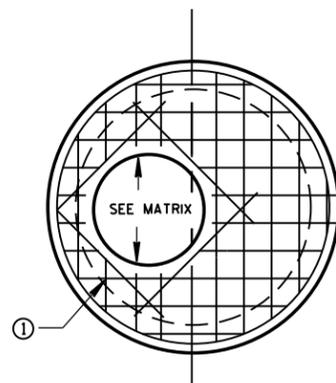


PLAN VIEW PRECAST REINFORCED CONCRETE FLAT SLAB TOP WITH ECCENTRIC OPENING


JOINTS TO BE SEALED WITH A BUTYL RUBBER SEAL PER SEALANT MANUFACTURERS RECOMMENDATIONS CONFORMING TO ASTM C990 (TYP)



TOP WITH PLAIN END JOINT



TOP WITH TONGUE AND GROOVE JOINT



RISER WITH TONGUE AND GROOVE JOINT

DETAIL "A"

**GENERAL NOTES**

DETAILS OF CONSTRUCTION, MATERIALS AND WORKMANSHIP NOT SHOWN ON THIS DRAWING SHALL CONFORM TO THE PERTINENT REQUIREMENTS OF THE STANDARD SPECIFICATIONS AND THE APPLICABLE SPECIAL PROVISIONS.

UNLESS OTHERWISE AUTHORIZED IN WRITING BY THE ENGINEER, THE CONTRACTOR SHALL NOT ORDER AND DELIVER PRECAST MANHOLE UNITS REQUIRED FOR THE PROJECT UNTIL A LIST OF SIZES IS FURNISHED BY THE ENGINEER.

DETAILED DRAWINGS FOR PROPOSED ALTERNATE DESIGNS FOR UNDERGROUND DRAINAGE STRUCTURES SHALL BE SUBMITTED TO THE ENGINEER FOR APPROVAL PROVIDING THAT SUCH ALTERNATE DESIGNS MAKE PROVISION FOR EQUIVALENT CAPACITY AND STRENGTH.

ALL DRAINAGE STRUCTURES ARE DESIGNATED ON THE PLANS AS "MANHOLES 4T-L", "MANHOLES 4S-M", ETC. THE VARIABLE TEE IS DENOTED BY 4T AND THE VARIABLE SPECIAL IS DENOTED BY 4S. THE FOLLOWING LETTER DESIGNATES THE TYPE OF COVER TO BE USED TO COMPRISE THE COMPLETE UNIT.

STEPS MEETING THE FOLLOWING REQUIREMENTS SHALL BE INSTALLED IN ALL STRUCTURES OVER 5 FEET IN DEPTH: 16 INCH C-C MAXIMUM SPACING; PROJECT A MINIMUM CLEAR DISTANCE OF 4 INCHES FROM THE WALL AT THE POINT OF EMBEDMENT; MINIMUM LENGTH OF 10 INCHES; MINIMUM WALL EMBEDMENT OF 3 INCHES. FERROUS METAL STEPS NOT PAINTED OR TREATED TO RESIST CORROSION SHALL HAVE A MINIMUM CROSS SECTIONAL DIMENSION OF 1 INCH.

STEPS OF APPROVED POLYPROPYLENE PLASTIC COATED REINFORCEMENT BAR ARE ACCEPTABLE. REINFORCING BAR MUST BE A MINIMUM OF 1/2 INCH AND MEET THE REQUIREMENTS OF ASTM A615.

CERTIFICATION SHALL BE PROVIDED THAT INSTALLED STEPS WHEN TESTED IN ACCORDANCE WITH SECTION 10 OF AASHTO T280 CAN WITHSTAND A VERTICAL LOAD OF 800 LBS. AND A HORIZONTAL LOAD OF 400 LBS.

PRECAST REINFORCED CONE TOPS (ECCENTRIC OR CONCENTRIC) OR PRECAST REINFORCED FLAT SLAB TOPS MAY BE USED ON CONCRETE OR CONCRETE BLOCK STRUCTURES. THE TOPS SHALL BE INSTALLED ON A BED OF MORTAR.

ECCENTRIC CONE TOPS MAY BE USED ON ALL STRUCTURES, AND CONCENTRIC CONE TOPS SHALL BE USED ONLY ON STRUCTURES 5 FEET OR LESS IN DEPTH, UNLESS OTHERWISE DIRECTED BY THE ENGINEER.

PRECAST REINFORCED RISERS SHALL HAVE A TONGUE AND GROOVE JOINT WITH TONGUE UP OR DOWN.

ALL BAR STEEL REINFORCEMENT SHALL BE EMBEDDED 2 INCHES CLEAR UNLESS OTHERWISE SHOWN OR NOTED.

ALL PRECAST MANHOLES SHALL CONFORM TO THE PERTINENT REQUIREMENTS OF AASHTO DESIGNATION M 199.

① FOR PRECAST MANHOLES PROVIDE REINFORCING STEEL IN ACCORDANCE WITH AASHTO M 199.

**MANHOLE COVER OPENING MATRIX**

MANHOLE COVER TYPE	C	ALL J'S	K	L	M
OPENING SIZE (FT)					
2 DIA.	X	X		X	
3 DIA.			X		X


**NOTES FOR MANHOLE VARIABLE SPECIAL 4-FT DIAMETER**

NOTE: ALL "A", "B", AND "C" BAR STEEL REINFORCING IS THE SAME DIAMETER WHICH VARIES WITH DEPTH.  
 NO. 5 BARS TO 20' DEPTH  
 NO. 6 BARS OVER 20' TO 30' DEPTH  
 NO. 7 BARS OVER 30' TO 40' DEPTH

THE "A" AND "B" BARS MAY BE PLACED IN ONE OR TWO SEGMENTS, AND SHALL LAP 24 BAR DIAMETERS.


"C" BARS SHALL HAVE STANDARD HOOKED ENDS.

NOTE: "T" THROUGHOUT LENGTH "L" SHALL BE 13" FOR PIPE DIAMETER 48" TO 84" AND 15" FOR PIPE DIAMETER GREATER THAN 84".

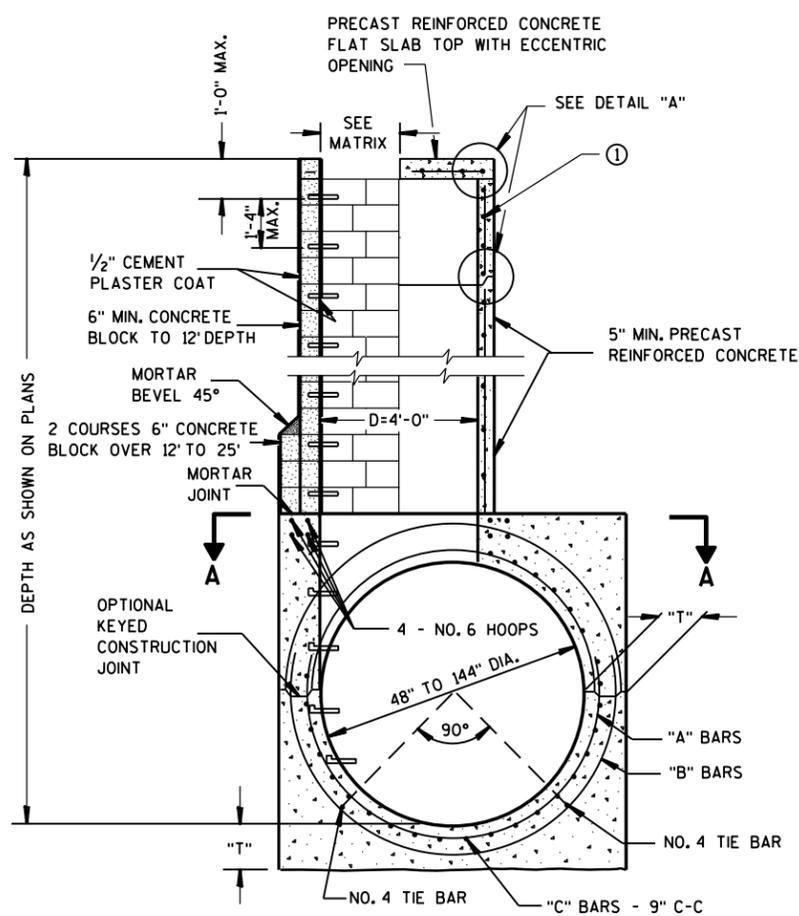

SECTION B-B

MANHOLE VARIABLE SPECIAL 4-FT DIAMETER

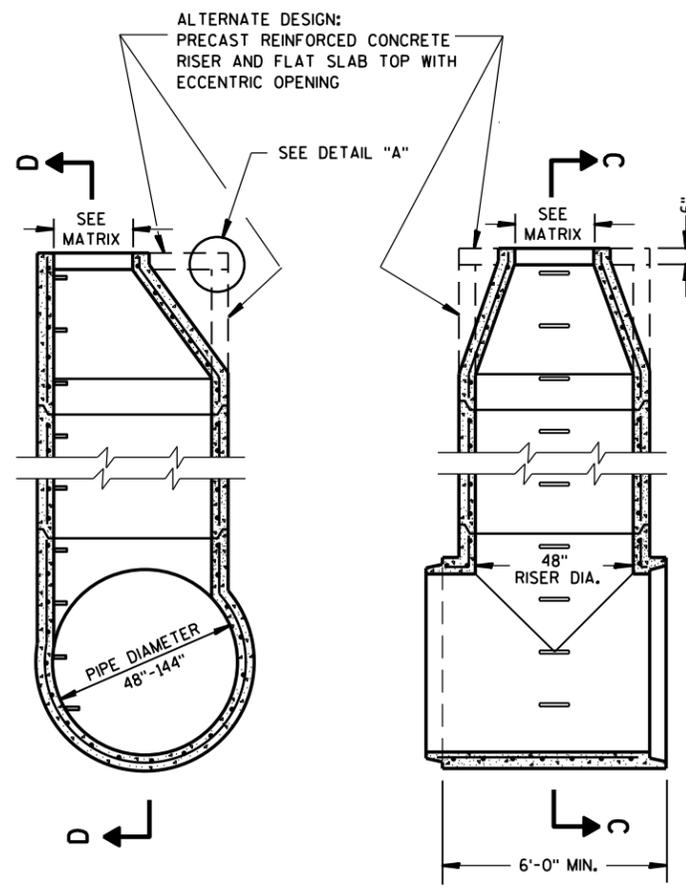

SECTION C-C

SECTION D-D

MANHOLE VARIABLE TEE 4-FT DIAMETER

**MANHOLE VARIABLE TEE AND SPECIAL 4-FT DIAMETER**

STATE OF WISCONSIN  
 DEPARTMENT OF TRANSPORTATION

APPROVED  
 Sept., 2016 /S/ Rodney Taylor  
 DATE ROADWAY STANDARDS DEVELOPMENT UNIT SUPERVISOR  
 FHWA

Manholes Variable Tee and Special 4-FT Diameter

References:

[FDM 13-25-15](#)

Bid items associated with this drawing:

<u>ITEM NUMBER</u>	<u>DESCRIPTION</u>	<u>UNIT</u>
611.2504	Manholes Variable Tee 4-FT Diameter.....	EACH
611.2604	Manholes Variable Special 4-FT Diameter .....	EACH

Standardized Special Provisions associated with this drawing:

<u>STSP NUMBER</u>	<u>TITLE</u>
NONE	

Other SDDs associated with this drawing:

- [SDD 8A5](#) Inlet cover sheets "b" and "d".
- [SDD 8D17](#) Manholes, Manhole and Inlet Covers

Design Notes:

Guidelines for matching manhole opening size and manhole covers are provided on the front side of this SDD.

Manholes should be used as follows:

1. For cleaning and maintenance locations spaced as recommended in FDM chapter 13
2. At changes in pipe size
3. At bends in pipe
4. Where flow needs to be split or diverted.

Contact Person:

Ed Lilla (608) 266-2312