




# 9H4: 2 Circuit Electrical Service Meter Breaker and Breaker Disconnect Box

## GENERAL NOTES

MINIMUM REQUIREMENT SHOWN. ADDITIONAL BREAKERS MAY BE REQUIRED.  
 UP TO THREE BREAKERS WILL BE CONSIDERED INCIDENTAL TO THE ITEM BREAKER DISCONNECT BOX.

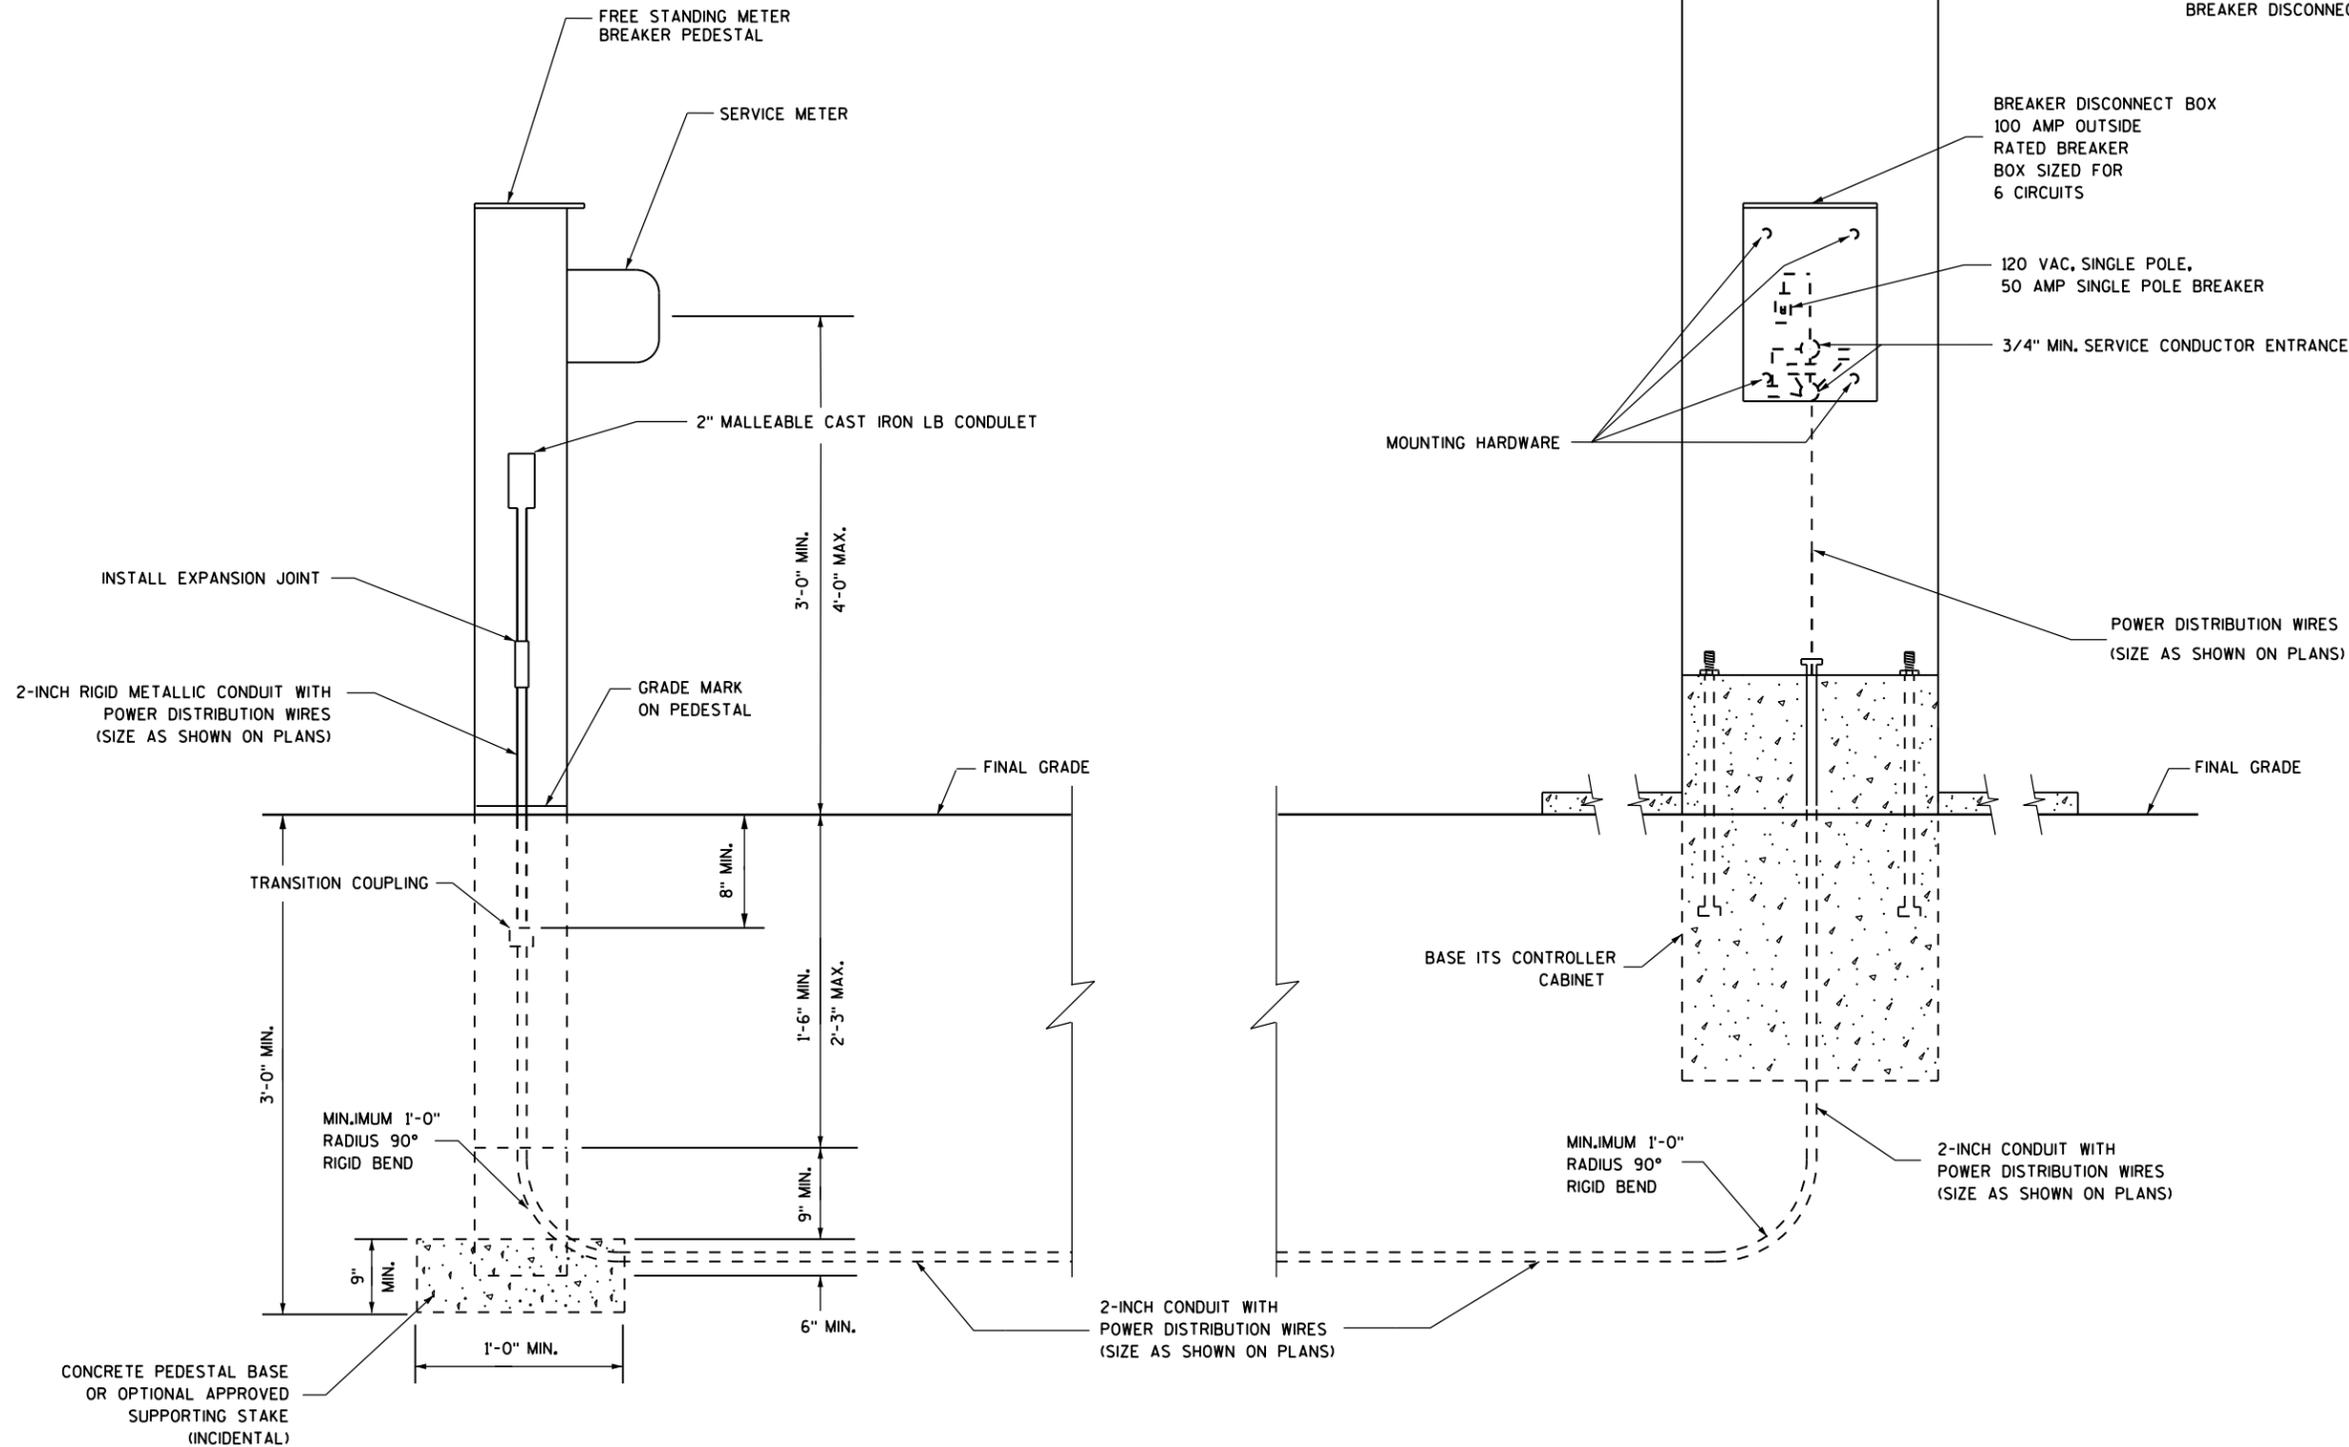

**2 CIRCUIT ELECTRICAL SERVICE METER  
 BREAKER PEDESTAL AND BREAKER DISCONNECT BOX**

**2 CIRCUIT ELECTRICAL SERVICE  
 METER BREAKER PEDESTAL AND  
 BREAKER DISCONNECT BOX**

STATE OF WISCONSIN  
 DEPARTMENT OF TRANSPORTATION

APPROVED  
 Sept. 2014 /S/ Ahmet Demirbilek  
 DATE STATE ELECTRICAL ENGINEER  
 FHWA

6

6

S.D.D. 9 H 4-1

S.D.D. 9 H 4-1

2 Circuit Electrical Service Meter Breaker and Breaker Disconnect Box

References:

NONE

Bid items associated with this drawing:

<u>ITEM NUMBER</u>	<u>DESCRIPTION</u>	<u>UNIT</u>
656.0200	Electrical Service Meter Breaker Pedestal (location).....	LS

Standardized Special Provisions associated with this drawing:

<u>STSP NUMBER</u>	<u>TITLE</u>
NONE	

Other SDDs associated with this drawing:

NONE

Design Notes:

NONE

Contact Person:

Ahmet Demirbilek (414) 220-6801